




Installation Instructions

8100S Series

INFORMER Series Motion Sensors

MODELS

8100S	50' x 40' (15 m x 12 m)
8140S	90' x 70' (27 m x 21 m)
8110S	120' x 10' (37 m x 3 m)
8120S	200' x 15' (61 m x 5 m)

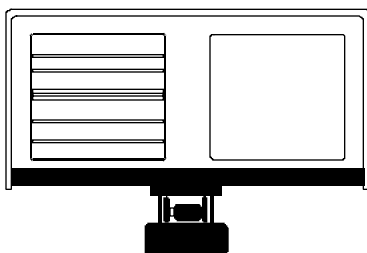

DUAL TEC motion sensors combine microwave and passive infrared (PIR) technologies to provide maximum catch performance, while virtually eliminating false alarms.

In addition, DUAL TEC motion sensors are truly supervised. 8100S series sensors are equipped with the INFORMER™ circuit, which constantly monitors the performance of both the microwave and PIR technologies. If a problem is detected, the INFORMER circuit will visually indicate trouble at the sensor (flashing alarm LED), and can electronically signal trouble to the control panel.

What's more, all DUAL TEC INFORMER sensors have a built-in Dualplex® transponder. The transponder transmits addresses and zone status data over the two power wires to almost any control panel (equipped with a Dualplex interface module).

Note: Use of the Dualplex Signaling System in UL listed installations will void the listing. For installations requiring a ULC certificate, the Dualplex transponder requires a listed, compatible subscriber's control unit that is equipped with a compatible interface module.

FEATURES

- Microwave/PIR technology
- INFORMER circuit
- Microwave supervision
- Alarm LED disable with trouble override
- Remote latching
- Built-in Dualplex transponder
- Low 35 mA current draw at 10 VDC
- Low voltage requirements
- High-security mounting bracket with optional NC tamper switches
- Energized Form C alarm relay
- RF immunity
- Unique "open edge" infrared detection logic
- Automatic temperature compensation
- Form C trouble relay (optional)

APPLICATION

Sensors in the 8100S series are designed for industrial and commercial applications.

MOUNTING PROCEDURE

Mounting Location

If possible, aim the unit toward the room's interior and away from windows, moving machinery, and heating or cooling sources. For more information, see the *Environmental Hazards* chart on page 3, and the *Difficult Applications* section on page 4.

Mounting the TWB-3 Bracket

Note: If you plan to install KM-11 tamper switches in the bracket, install the bracket cover tamper switch BEFORE mounting the bracket. Refer to *Assembling the TWB-3 Bracket*, Step 2.

Mount the high-security wall bracket (see Figure 1, item 6) on a solid surface, preferably a load-bearing stud, and attach it with four #10 1-3/4" screws.


If it is necessary to attach the bracket directly to a wall, use four 3/16" x 3" toggle bolts.

Assembling the TWB-3 Bracket

Step 1: Remove the bracket hardware from the plastic bag.

Step 2: TAMPER SWITCH OPTION. Follow this step if you plan to install KM-11 tamper switches in the TWB-3 bracket. If not, proceed to Step 3.

Figure 1 High-Security Mounting Bracket

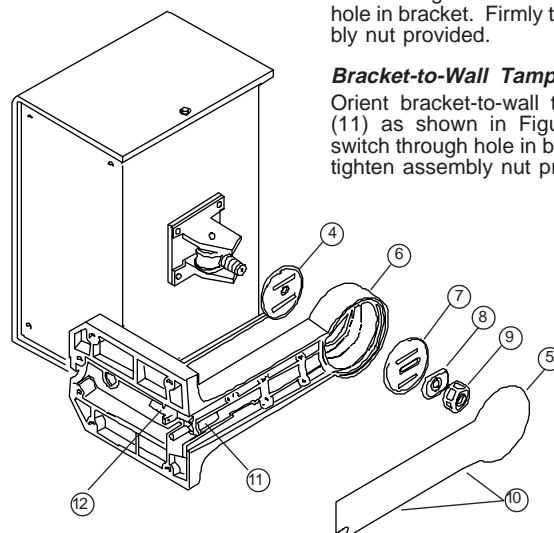

Bracket Cover Tamper Switch

Orient cover tamper switch (12) as shown in Figure 1. Insert switch through hole in bracket. Firmly tighten assembly nut provided.

Bracket-to-Wall Tamper Switch

Orient bracket-to-wall tamper switch (11) as shown in Figure 1. Insert switch through hole in bracket. Firmly tighten assembly nut provided.

Step 3: Connect the sensor to the bracket (6) using the bracket adaptor plug (4), bracket retainer plate (7), bracket washer (8), and 3/8-16 hex nut (9) in the sequence and orientation shown in Figure 1.

Step 4: Put the cover (10) on the bracket and attach it with the four screws provided.

WIRING

Remove the sensor's cover by removing the screws on its sides.

Feed the wires into the sensor through the hole in the bottom of the housing.

The terminal strip is located on the left side of the printed circuit board (PCB). Connect the wires to the terminal strip as shown in Figure 2 (use 22 to 14 AWG).

Note: This sensor is DC powered. If the proper polarity is not observed (when wiring), the fuse on the PCB will blow.

Figure 2 8100S Series Terminal Strip

10	C	TAMPER 50 mA, 30 VDC
9	NC	
8	NO	ALARM 500 mA, 30 VDC
7	C	
6	NC	TROUBLE 500 mA, 30 VDC (Optional)
5	NC	
4	C	POWER 7 - 14 VDC 35 mA, 10 VDC
3	NO	
2	V-	
1	V+	

ACTIVATING THE TRANSPONDER

Note: For the Dualplex transponder to operate, it must be connected to the Dualplex interface module (Model DP8 or DP8-L).

Each model in the 8100S series has a built-in Dualplex transponder. The transponder eliminates the need for separate relays and extra wires by using the two power wires from the Dualplex interface module to transmit zone status data to the control panel. With the addition of the Dualplex interface module, almost any conventional panel can be turned into a Dualplex control.

The Dualplex transponder has eight address settings, and can signal both alarm and trouble to the control panel. The transponder will signal trouble when activated by the INFORMER circuit, microwave supervisory circuit, or a violation of the cover tamper switch.


Wiring the Transponder

Observing the proper polarity, connect the wires from the Dualplex interface module to terminals #1 (V+) and #2 (V-) of each sensor.

Setting a Sensor's Address

The S1 DIP switch is located at the top center of the PCB. To set the address of a sensor, use positions #1, #2, and #3 on the S1 DIP switch (refer to Figure 3).

Figure 3 Using the S1 DIP Switch

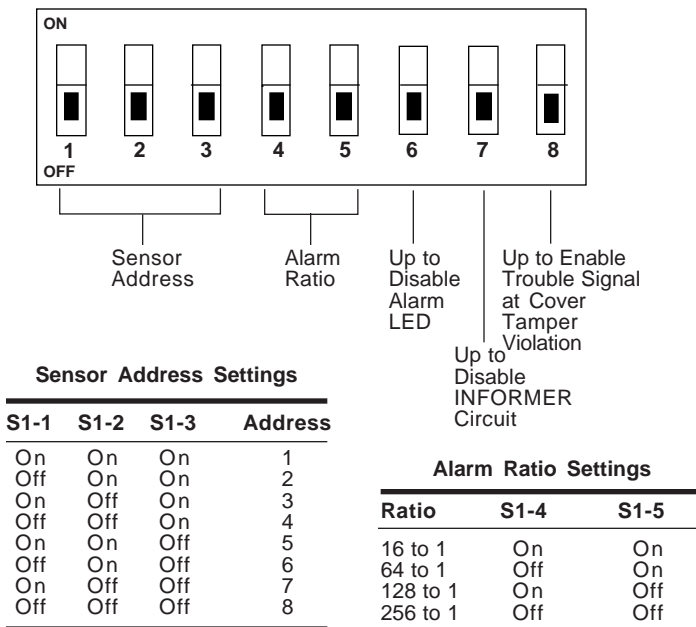

TRUE SUPERVISION OF THE MICROWAVE AND PIR

Each DUAL TEC INFORMER sensor is equipped with traditional microwave supervision, and a second fail-safe system called the INFORMER circuit.

Traditional Microwave Supervision

If the microwave detector stops transmitting or receiving signals, it locks into an alarm condition and the sensor signals trouble. The sensor then continues to operate as PIR only.

If the microwave detector is blocked or masked, the resulting feedback will also cause the microwave supervisory circuit to signal trouble.

If the blockage or mask is removed, the sensor will return to dual technology operation, and the alarm LED will reset.

Note: Should the microwave detector be MASKED, it is possible that the sensor will not switch to PIR only, even though the INFORMER circuit will detect the masking and signal a trouble alert at the sensor (flashing alarm LED).

However, should the microwave detector FAIL, the failure will be detected by the microwave supervisory circuit. Trouble will be signaled visually at the sensor (flashing alarm LED), and the sensor will switch to PIR only.

When any trouble alert occurs, be certain to walk-test the sensor before returning it to normal operation.

The INFORMER Circuit

The INFORMER circuit counts the number of events registered by both the microwave and PIR technologies, then uses the resulting ratio to determine if either technology is blocked, masked, misapplied, sleeping, or working properly.

INFORMER Ratios

The INFORMER circuit can be set to use one of four alarm ratios: 16 to 1, 64 to 1, 128 to 1, or 256 to 1. Use higher ratios for high traffic areas, and lower ratios for low traffic areas.

An alarm ratio of 128 to 1 is suggested for most occupied environments. This means that before one technology registers 128 alarms, the other must register at least one. If it does not, trouble will be signaled.

Use switches #4 and #5 on the S1 DIP switch to set the alarm ratios (refer to Figure 3).

Note: If alarms register too rapidly on either technology, the INFORMER circuit will disable itself for eight minutes. This feature allows the INFORMER circuit to compensate for temporary environmental disturbances.

INFORMER Circuit Enable

The INFORMER circuit is shipped from the factory **disabled**. To enable the INFORMER circuit, move position #7 on the S1 DIP switch to the down (Off) position.

Note: Disabling the INFORMER circuit will not disable the microwave supervision. The microwave supervisory circuit will continue to detect microwave masking or failure.

TROUBLE SIGNALING

The Trouble Relay

An optional Form C trouble relay (part # RY-0020) can be used with sensors in the 8100S series. The trouble relay can be activated by the microwave supervisory circuit, the INFORMER circuit, or a violation of the cover tamper switch.

Alarm LED Disable with Trouble Override

The alarm LED can be disabled by moving position #6 on the S1 DIP switch to the up (On) position. Refer to Figure 3.

However, even if the alarm LED is disabled, a trouble alert will override the disable and make the alarm LED flash. As a result, you can disable the alarm LED so that potential intruders can't test the protection coverage, yet remain confident that your DUAL TEC INFORMER sensor is operational.

FINAL ADJUSTMENT & WALK-TEST

DUAL TEC motion sensors are equipped with two diagnostic LEDs: green for PIR and yellow for MICROWAVE. The red LED is used to indicate an alarm condition and trouble alert.

Note: All the diagnostic LEDs of models in the 8100S series are located at the front of the sensor. The diagnostic LEDs only operate when the sensor's cover is off.

Apply power to the sensor and let it warm up for at least three minutes. Begin walk-testing when all three LEDs have gone out.

Aiming

To provide maximum area coverage, the sensor must be aimed properly and have a clear line of sight to all areas you wish to protect. PIR energy cannot penetrate solid objects. If the sensor is blocked, it will not alarm.

The angle at which the sensor's head is set is critical to obtaining desired range. Refer to Figure 4 to determine the proper angle for your application.

	Model	Range	Mounting Height			
			12'	10'	8'	6'
Figure 4 Mounting Angle of Declination	8100S	50'	9°	6°	4°	2°
	8140S	90'	5°	3°	2°	1°
	8110S	120'	3°	2°	1°	0°
	8120S	200'	2°	1°	1°	0°

Range Adjustment

A range potentiometer for the microwave is located at the upper right corner of the PCB. Turning the thumbwheel from right to left INCREASES the range.

Before walk-testing the sensor, set the microwave potentiometer at minimum by turning it all the way to the right. (The potentiometer is factory-set at maximum.) Then, as you perform the walk-test, gradually increase the sensitivity of the microwave until the desired range is obtained.

The range of the PIR is determined by height, angle, and aiming. Refer to the Aiming section and the Angle of Declination chart for more information.

Walk-Test

Walk across the protected area at the ranges to be covered. Two to four normal steps should make the diagnostic LEDs light. The red LED should indicate an alarm condition.

When there is no motion in the protected area, all three LEDs should be off.

Replace the sensor's front cover and repeat the walk-test. Two to four normal steps should make the red alarm LED light (unless it has been disabled).


INSTALLATION HINT FOR MODEL 8120S

Like other models in the 8100S series, the 8120S is equipped with single edge PIR triggering. Crossing just one edge of any zone will put the PIR in alarm.


At a distance of 200', the edges of the main zone are 15' apart. To insure that an intruder will cross one edge of the zone, the unit must be carefully aimed.

When mounting the 8120S in a long, narrow corridor, aim one edge of the main zone at the most distant point to be covered.

CENTER MOUNTING: Aim the 8120S 2.25° to the side to send one edge of the main zone down the middle. Do not aim straight.

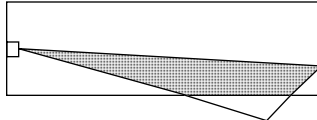

CORNER MOUNTING: Aim the 8120S 4.5° to 5° to the side to send one edge of the main zone diagonally across the distance.

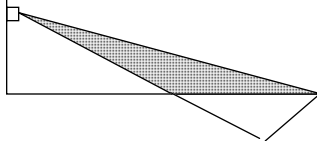

THE INFORMER TROUBLE ALERT

If the microwave and PIR register enough events to satisfy the preset ratio (16 to 1, 64 to 1, etc.), the INFORMER circuit will reset and begin the counting process again. However, if the alarm ratio is not met, the INFORMER circuit will signal trouble.

Diagnostic LEDs

A flashing alarm LED can indicate three types of trouble: ratio imbalance, microwave failure (masking included), or tampering.

If the trouble is a ratio imbalance, the diagnostic LED of the technology that reached the full count of alarms will also flash (when the sensor's cover is off).

INFORMER Circuit Reset

The INFORMER circuit automatically resets when the technology that triggered the trouble condition resumes detection and is working properly.

The Troubleshooting Matrix

The troubleshooting matrix describes three trouble alerts: two reported by the INFORMER circuit, one by the microwave supervision circuit. Refer to Figure 5.

To use the troubleshooting matrix:

- Find the trouble alert that describes the condition of the walk-test LEDs (with no motion in the protected area).
- Walk-test the sensor, carefully watching the reaction of the diagnostic LEDs.
- Refer to the *Possible Causes* column of the matrix for an explanation of the way in which the diagnostic LEDs reacted to the walk-test.
- The alarm LED will continually flash regardless of motion in the protected area.
- Only the diagnostic LEDs will react to the walk-test (when the sensor's cover is off).

Condition of LEDs with No Motion			Reaction of LEDs to Walk-Test			Type of Problem	Possible Causes
PIR (Green)	ALARM (Red)	MW (Yellow)	PIR (Green)	ALARM (Red)	MW (Yellow)		
Off	Flash	Flash	On	Flash	On	RATIO IMBALANCE	MW environmental problem MW unstable MW range too long PIR was blocked
			Off	Flash	On	RATIO IMBALANCE	PIR range too short PIR aimed wrong PIR asleep
Flash	Flash	Off	On	Flash	On	RATIO IMBALANCE	PIR environmental problem PIR unstable MW range too short
			On	Flash	Off	RATIO IMBALANCE	MW range too short MW asleep
Off	Flash	Off	On	Flash	On	MICROWAVE SUPERVISION	MW is masked
			On	Flash	Off	MICROWAVE SUPERVISION	MW asleep

Figure 5 INFORMER Troubleshooting Matrix

INFORMER EXAMPLES

Misapplied Sensor: Suppose that the motion sensor is improperly aimed or adjusted. If one technology is too sensitive, it can register the full count of alarms before the other technology registers even one.

Blocked PIR: Suppose that boxes are stacked in front of the motion sensor. Since the PIR can't see through solid objects, it won't be able to register alarms.

But the microwave can see through (or around) most non-metallic objects and should be able to register alarms. As a result, when it reaches the set alarm ratio, trouble will be signaled.

Sleeping Technology: Suppose one technology is sleeping. The other technology will continue to register events until the set ratio is reached (unless the microwave has stopped transmitting and receiving signals).

Masked Microwave: Suppose that the motion sensor is masked with metal foil. Like the PIR, the microwave can't see through metal and won't be able to register alarms.

However, even if the microwave is masked by metal, the resulting feedback will cause the microwave supervision circuit to signal trouble.

ENVIRONMENTAL HAZARDS

In order for the INFORMER circuit to work properly, each technology must be set up so that it will not be regularly tripped by environmental disturbances.

Use the *Environmental Hazards* chart (Figure 6) to verify that all environmental hazards have been considered in the location and set-up of the motion sensor.

	PIR	MICROWAVE
Vibration	Very few problems	Can be major problem
Reflection in pattern by large metal objects	No problem unless metal highly polished	Can be major problem
Sensitivity to movement of overhead doors	Very few problems	Can be major problem
Sensitivity to small animals	Problem if animal close, but aim can be changed or mask used	Problem if animal close
Water movement in plastic pipes	No problem	Can be problem if close
Movement through thin walls or glass	No problem	Needs careful placement
Drafts, air movement	Needs careful placement	No problem
Sun, car headlights	Needs careful placement	No problem
Heaters	Needs careful placement	No problem
Moving machinery	Very few problems	Needs careful placement
Radar interference	Very few problems	Can be problem if close
Fluorescent lights	No problem	Can be problem if close

Figure 6 Environmental Hazards and Other Variables

AMPLIFIER OUTPUT VOLTAGE

The amplifier output is a valuable diagnostic tool. It enables you to see what the microwave signal processing circuit is seeing.

To use the amplifier output, connect one wire to the **TP5 pin (+)** at the center of the right side of the PCB. Connect a second wire to the **TP2 pin (-)** at the upper right corner of the PCB.

Run the two wires to a convenient location **outside** the protected area, then connect them to the 10 VDC scale of your multimeter. You should read approximately 5.0 VDC* with no motion in the protected area.

Have an assistant walk into the protected area. If the motion is sufficient to keep the amplifier output voltage 0.6 V below the 5.0 VDC* threshold for two seconds, the microwave detector is seeing a disturbance sufficient enough to cause an alarm.

*Note: 5.0 VDC is a nominal threshold voltage. DUAL TEC motion sensors are designed with a floating threshold. Thus, if slight motion or extensive fluorescent lighting is present within the pattern, the amplifier output voltage will stabilize below 5.0 VDC.

DIFFICULT APPLICATIONS

Cold Extreme cold will not damage DUAL TEC motion sensors. They will remain operational at temperatures as low as 32° F (0° C).

Aisles & Corridors PIRs are usually not sensitive to direct into/away from motion. However, DUAL TEC sensors have a unique "open edge" infrared detection logic that allows for detection when only one of the elements has been violated. This gives you better "down the throat" catch performance, plus faster response at maximum range.

Overhead Heaters If possible, aim the sensor across or underneath an overhead heater.

If this is not possible, mask the heater with 1/4" chicken wire mesh (or a finer mesh metal screen) to prevent the microwave from seeing the motion of the fan blades.

Heat PIRs can lose range as room temperature nears body temperature. However, DUAL TEC motion sensors automatically compensate for temperature changes and do not lose range.

Windows DUAL TEC sensors should be aimed across or away from outside windows, not at them.

If this cannot be avoided, aim the sensor so that the top of the PIR zones hit the floor at the base of the windows.

Drafts PIR and ultrasonic devices can be tripped by air turbulence. But because the DUAL TEC sensor is a combination of microwave and PIR technologies, drafts cannot make it false alarm. Its microwave detector is not sensitive to air turbulence.

PRODUCT SPECIFICATIONS

Alarm relay & (optional) trouble relay:

Form C
500 mA, 30 VDC

Tamper switch:

Form A
NC (when depressed)
50 mA, 30 VDC

Circuit protection:

Line fuse type 3 AG
0.250 A
1-1/4" x 1/4" glass tube

Power requirements:

7 to 14 VDC
35 mA, 10 VDC

Frequencies:

Center band 10.525 GHz
Multiple units can be used in same area without mutual interference

RF immunity:

Up to 100 watts at 10' (3 m) from all mobile bands 27-1000 MHz

Sensitivity:

2-4 normal steps within field of view

Shipping weight:

7 lbs (3 kg)

Dimensions:

8" x 5-1/2" x 4"
(20 cm x 14 cm x 10 cm)

Operating temperature:

32° to 120° F (0° C to 49° C)

Automatic temperature compensation:

Range does not decrease as room temperature nears body temperature

Approvals:

FCC certified DOC certified
UL/ULC* listed DTI approved


Accessories

RY-0020 Form C trouble relay
RY-0025 Package of five (5) Form C trouble relays
DP8or DP8-L Dualplex interface module
KM-11 Tamper switches
BD 81XS Environmental (outdoor) housing
81XS-OR Or-gate board


*Note: The ULC label or listed marking on a product is the only evidence provided by Underwriters Laboratories of Canada to identify products that have been produced under the Listing and Follow-up Service.

DETECTION PATTERNS

8110S/8120S

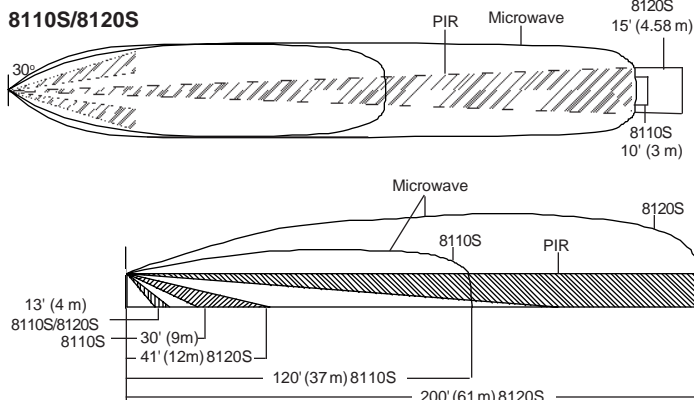

8100S/8140S

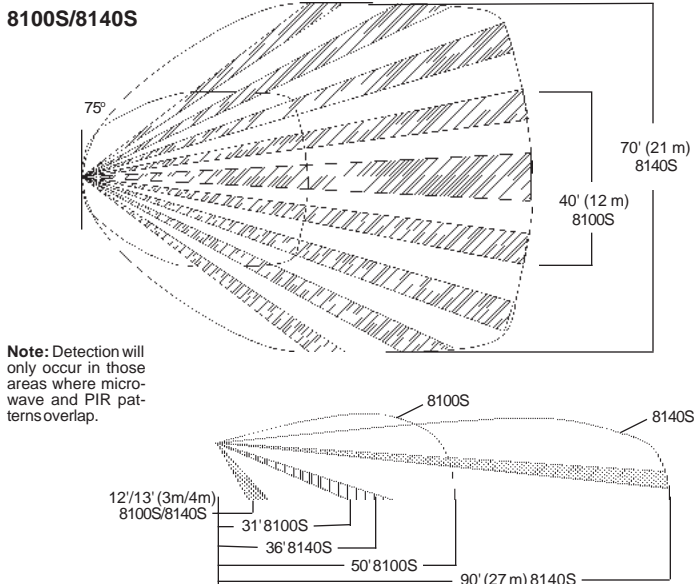

Note: Detection will only occur in those areas where microwave and PIR patterns overlap.

The 8100S series sensors should be tested at least once each year to ensure proper operation.

Important: The 8100S series sensors must be connected to a UL listed power supply or UL listed control unit capable of providing a minimum of four hours of standby power.

This equipment has been tested and found to comply with the limits for a field disturbance sensor, pursuant to Part 15 of the FCC Rules. The user is cautioned that changes or modifications not expressly approved by C&K Systems could void the user's authority to operate this equipment.

LIMITED WARRANTY

Seller warrants its products to be in conformance with its own plans and specifications and to be free from defects in materials and workmanship under normal use and service for 18 months from the date stamp control on the product or for products not having a C&K Systems date stamp, for 12 months from the date of original purchase, unless the installation instructions or catalogue sets forth a shorter period, in which case the shorter period shall apply. Seller's obligation shall be limited to repairing or replacing, at its option, free of charge for materials or labor, any part which is proved not in compliance with Seller's specifications or proves defective in materials or workmanship under normal use and service. This warranty is void if the product is altered or improperly repaired or serviced by anyone other than C&K Systems factory service. For warranty service, return the product transportation prepaid to C&K Factory Service, 107 Woodmere Road, Folsom, California, 95630.

THERE ARE NO WARRANTIES, EXPRESS OR IMPLIED, OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE OR OTHERWISE, WHICH EXTEND BEYOND THE DESCRIPTION ON THE FACE HEREOF. In no case shall Seller be liable to anyone for any consequential or incidental damages for breach of this or any other warranty, express or implied, or upon any other basis of liability whatsoever, even if the loss or damage is caused by Seller's own negligence or fault.

Seller does not represent that its product may not be compromised or circumvented; that the product will prevent any personal injury or property loss by burglary, robbery, fire or otherwise; or that the product will in all cases provide adequate warning or protection. Buyer understands that a properly installed and maintained alarm may only reduce the risk of burglary, robbery, or fire without warning, but it is not insurance or a guarantee that such will not occur or that there will be no personal injury or property loss as a result. CONSEQUENTLY, SELLER SHALL HAVE NO LIABILITY FOR ANY PERSONAL INJURY, PROPERTY DAMAGE, OR OTHER LOSS BASED ON A CLAIM THAT THE PRODUCT FAILED TO GIVE WARNING. However, if Seller be held liable, whether directly or indirectly, for any loss or damage arising under this Limited Warranty or otherwise, regardless of cause or origin, Seller's maximum liability shall not in any case exceed the purchase price of the product, which shall be fixed as liquidated damages and not as a penalty, and shall be the complete and exclusive remedy against Seller.

This warranty replaces all previous warranties and is the only warranty made by C&K Systems on this product. No increase or alteration, written or verbal, of the obligation of this warranty is authorized.



107 Woodmere Road
Folsom, CA 95630
(916) 351-1131 or 1(800) 227-8065
FAX (916) 985-0352

5-051-100-00 Rev F
Printed in Hong Kong
US Patents 3,703,718, 4,710,750 and 4,771,273.
Other US and International Patents Applied For.

Copyright 1993 C&K Systems, Inc.
C&K is a registered trademark of C&K Components, Inc.
DUAL TEC and Dualplex are registered trademarks of C&K Systems, Inc. DUAL TEC INFORMER is a trademark of C&K Systems, Inc.